



NOTE:

MISC. LAKEWOOD FOOD COURT DETAILS. TENANT IS REQUIRED TO FIELD VERIFY CONDITIONS.

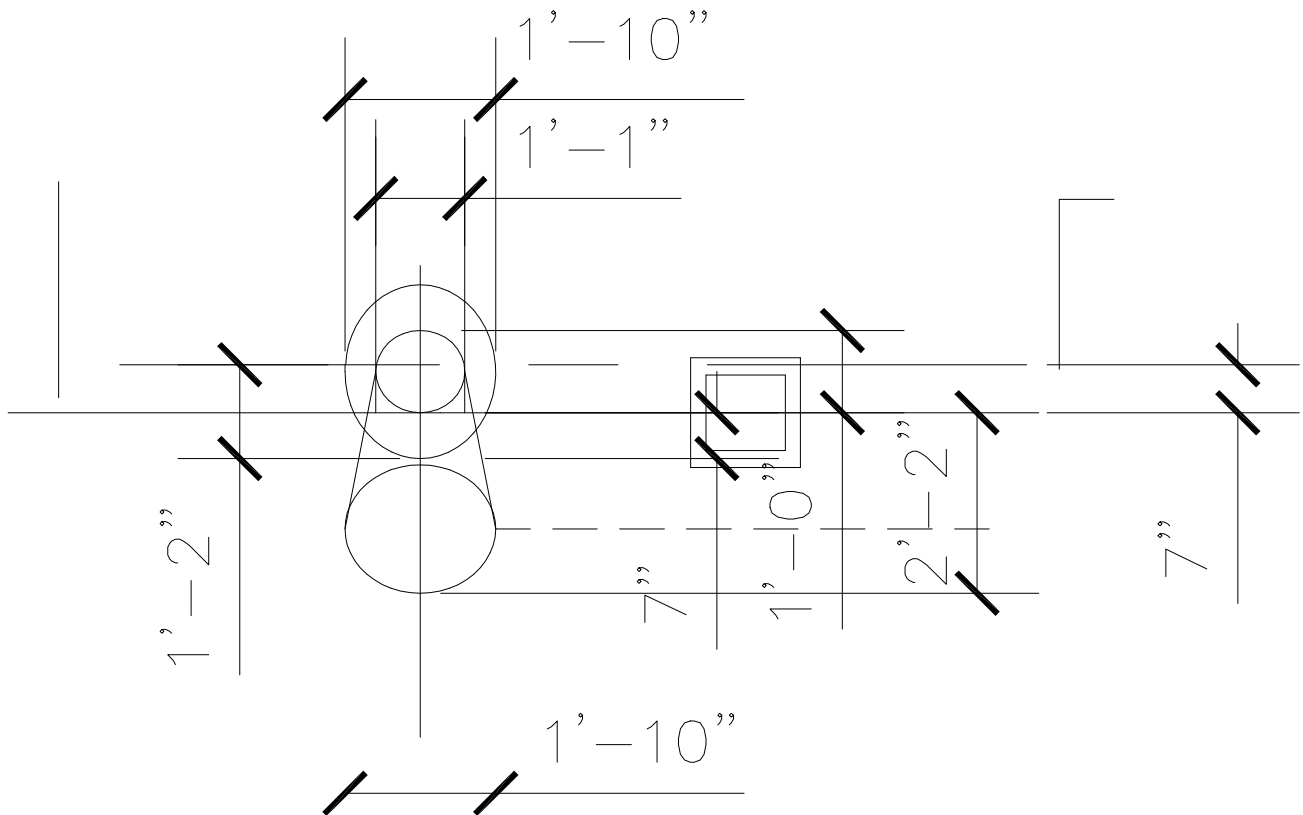



COVER SHEET

WHEN TENANT EXITS INTO SERVICE
CORRIDOR DOORS MUST BACKSET
PREVENT OBSTRUCTION OF CORRIDOR.

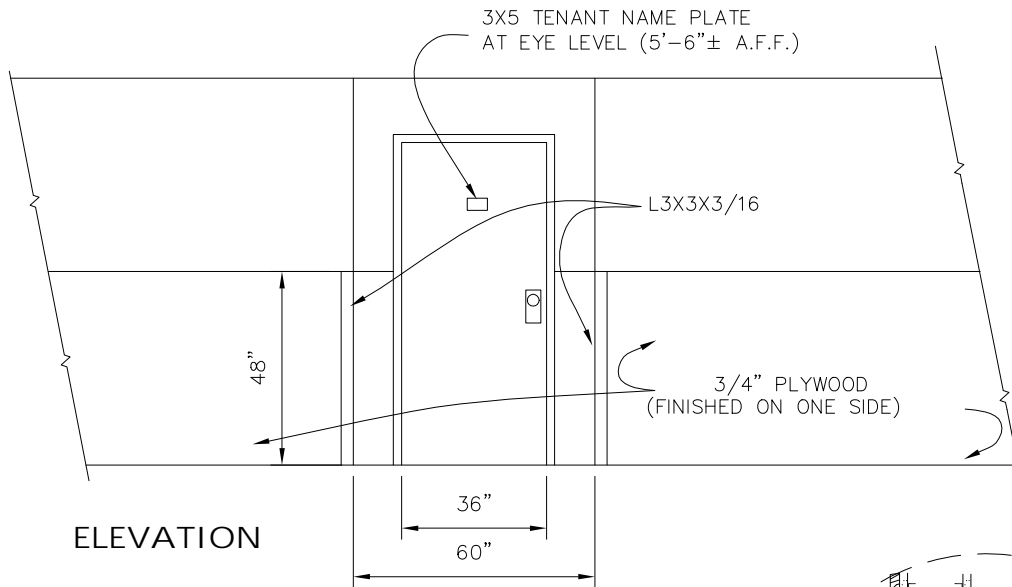


3/4" PLYWOOD MUST BE IN NEW
CONDITION AND FINISHED AS
INSTRUCTED BY LANDLORD'S
ON SITE REPRESENTATIVE.

L3X3X3/16 - FASTEN TO WALL WITH
LAG SCREW. LAG SCREWS SHALL
PENETRATE PLYWOOD AND GYP. BD.
PLYWOOD AND GYP. BD. AND BE
SECURED IN METAL STUD FRAMING.

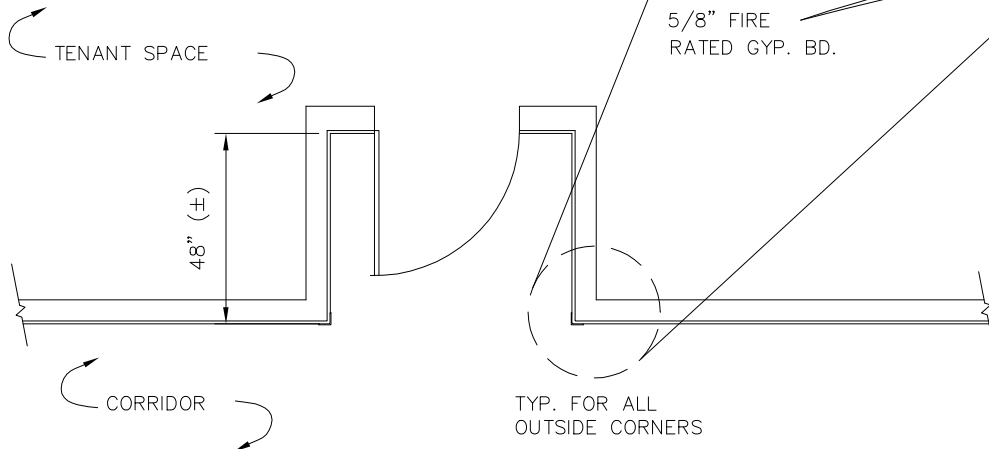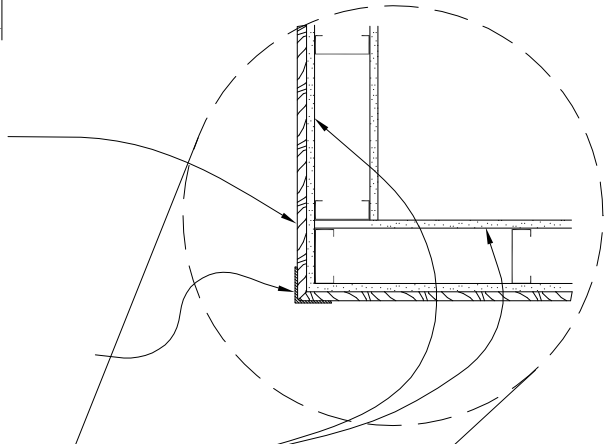


PLAN VIEW

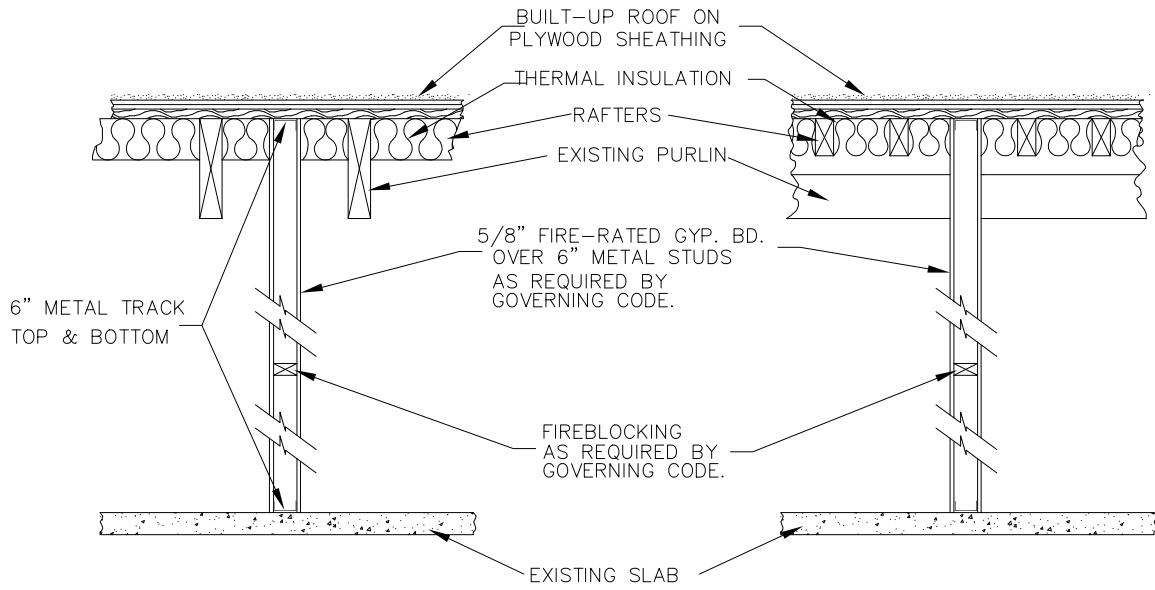

DEMISING WALL (TYP)

WOOD DECK ONLY

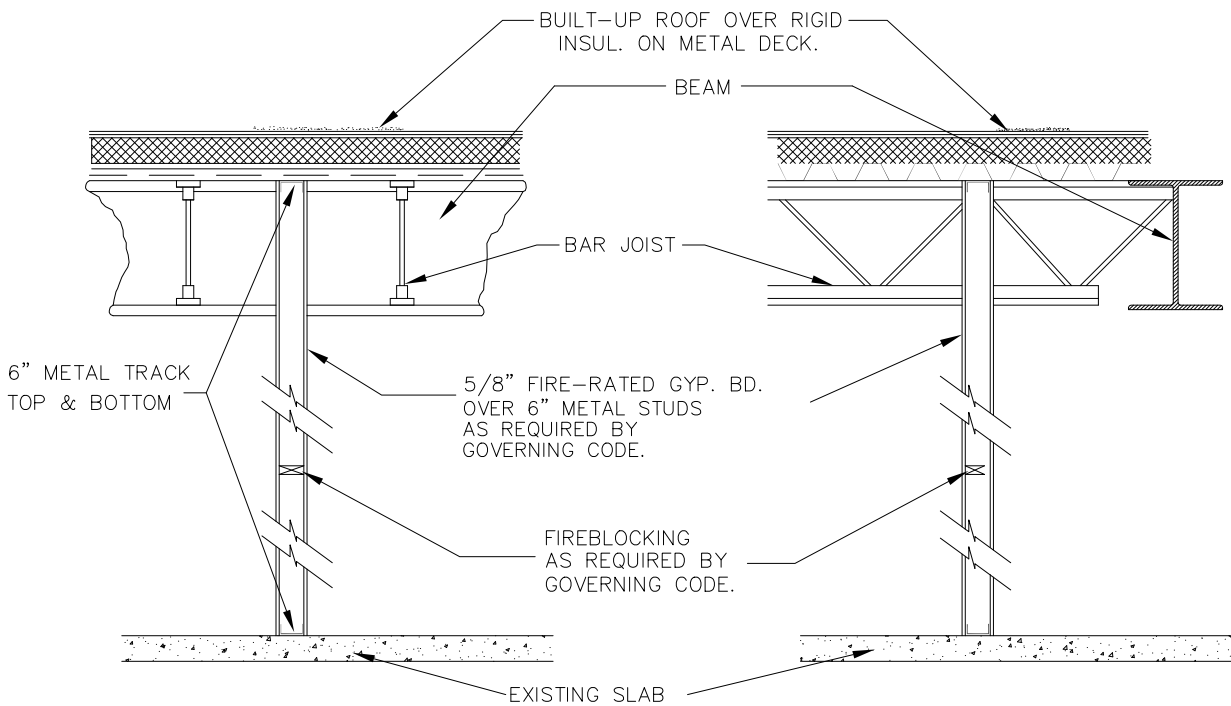


DEMISING WALL (TYP)

METAL DECK ONLY


NOTE:

DETAILS ON THIS SHEET DO NOT NECESSARILY APPLY TO ALL TENANT SPACES. TENANTS MUST VERIFY WHICH CONDITIONS EXIST IN THEIR OWN LOCATIONS.

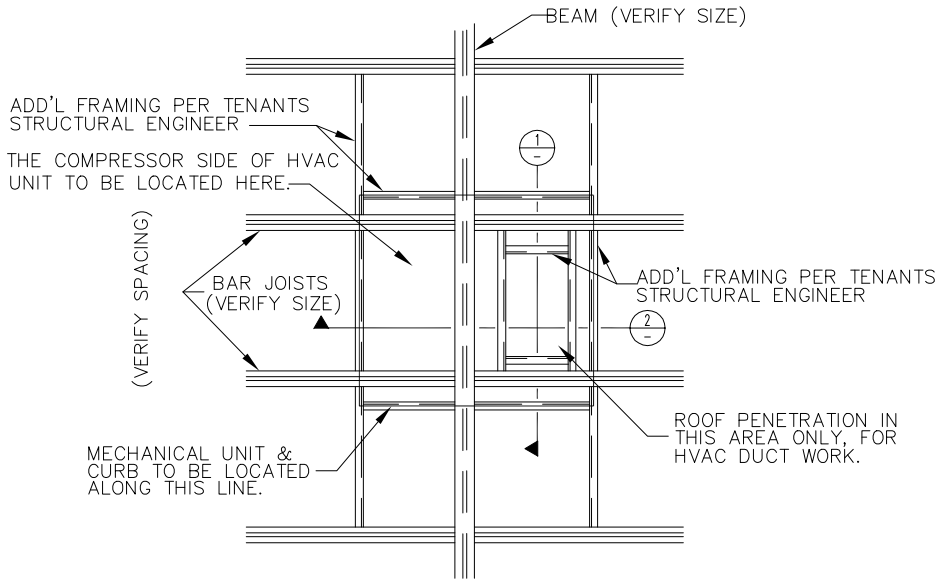

HVAC FRAMING LAYOUT

NOT TO SCALE

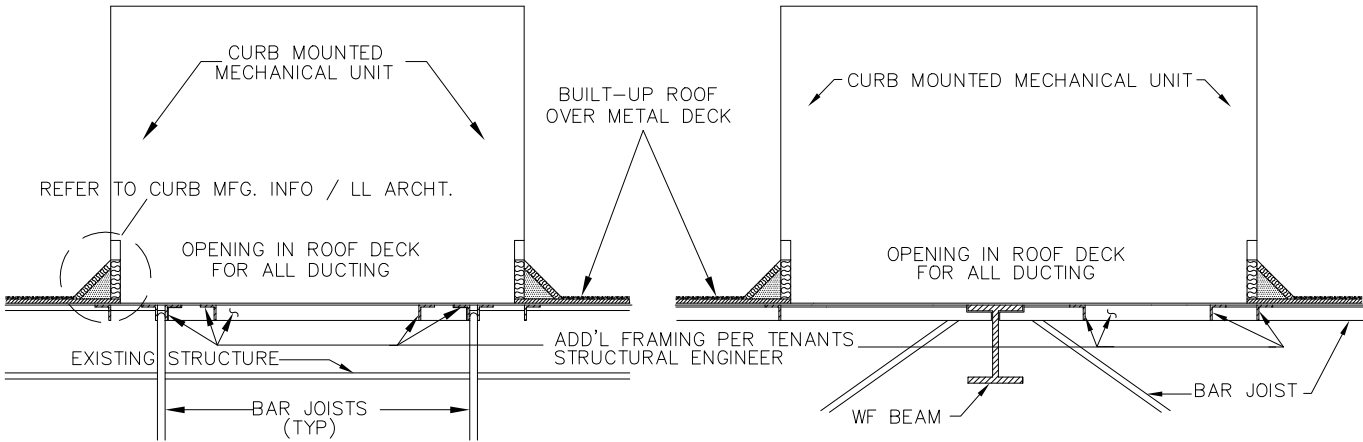

SECTION 1

NOT TO SCALE

SECTION 2

NOT TO SCALE


HVAC NOTES:

1. THE HVAC UNIT SHALL BE LOCATED OVER A STRUCTURAL BEAM.
2. DO NOT REMOVE ANY STRUCTURAL OR ANY MISC. STEEL INCLUDING BRIDGING AND OR BLOCKING.
3. THE TENANT IS RESPONSIBLE TO PROVIDE VERIFICATION BY A STRUCTURAL ENGINEER THAT THE HVAC UNIT IS ADEQUATELY SUPPORTED.
4. IF ANY OF THE REQUIREMENTS CAN NOT BE ACHIEVED, IT IS THE TENANTS RESPONSIBLTY TO NOTIFY THE LANDLORD IN WRITING AND SUBMIT AN ALTERNATE PLAN.
5. DETAILS ON THIS SHEET DO NOT NECESSARILY APPLY TO ALL TENANT SPACES. TENANTS MUST VERIFY WHICH CONDITIONS EXIST IN THEIR OWN LOCATION.

NOTE:


DETAILS ON THIS SHEET DO NOT NECESSARILY APPLY TO ALL TENANT SPACES. TENANTS MUST VERIFY WHICH CONDITIONS EXIST IN THEIR OWN LOCATIONS.

SHEET 3

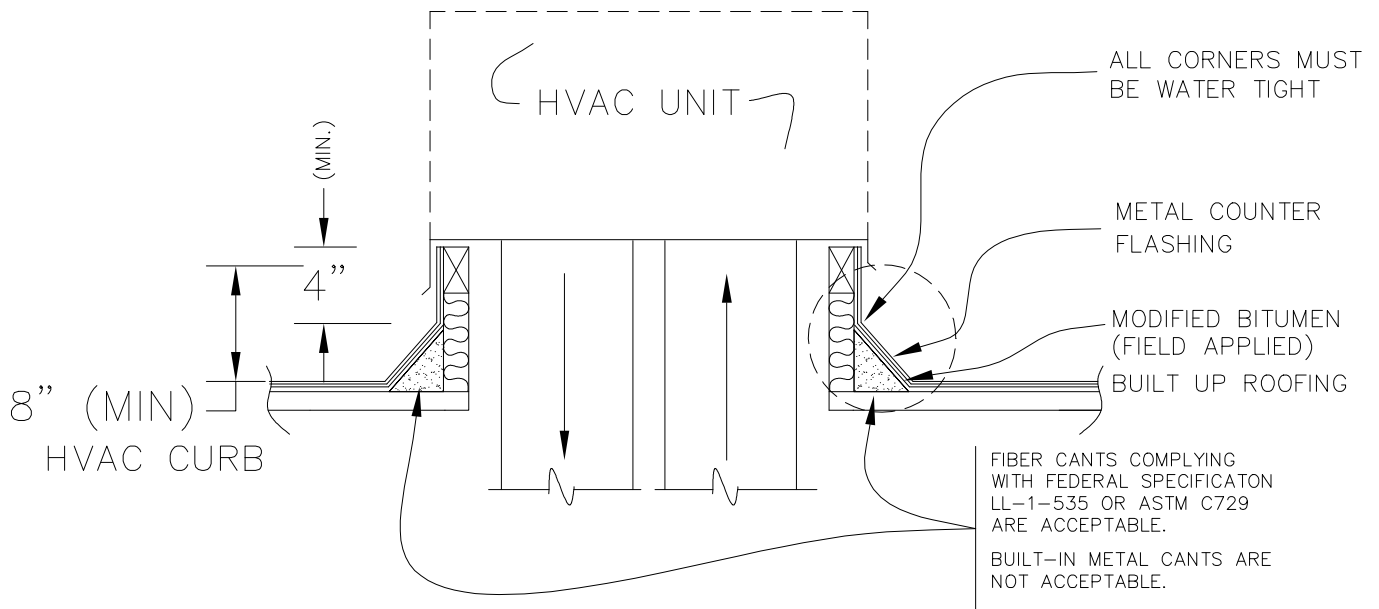

CURB DETAIL


HVAC ROOFTOP UNIT ON FACTORY CURB OVER TENANT SPACE

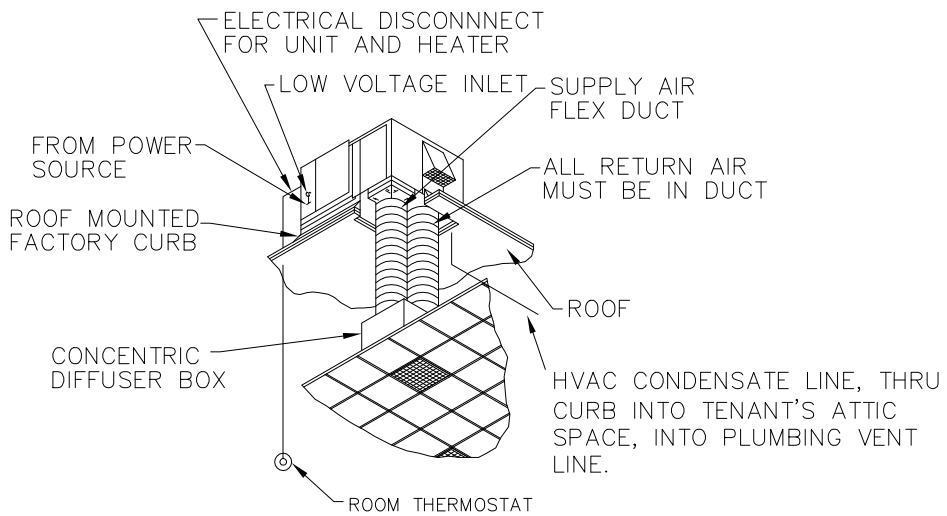

MECHANICAL UNIT


NOTE:

DETAILS ON THIS SHEET DO NOT NECESSARILY APPLY TO ALL TENANT SPACES. TENANTS MUST VERIFY WHICH CONDITIONS EXIST IN THEIR OWN LOCATIONS.

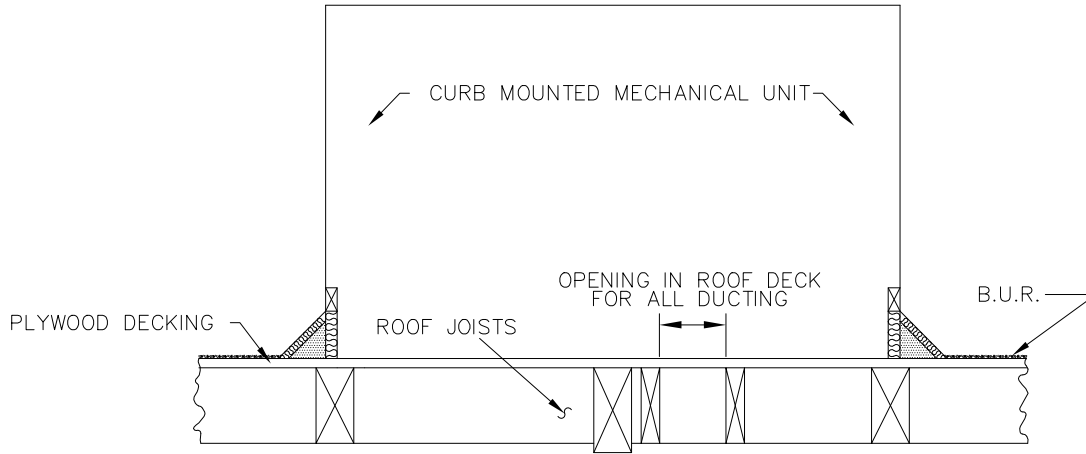


SECTION 2

NOT TO SCALE

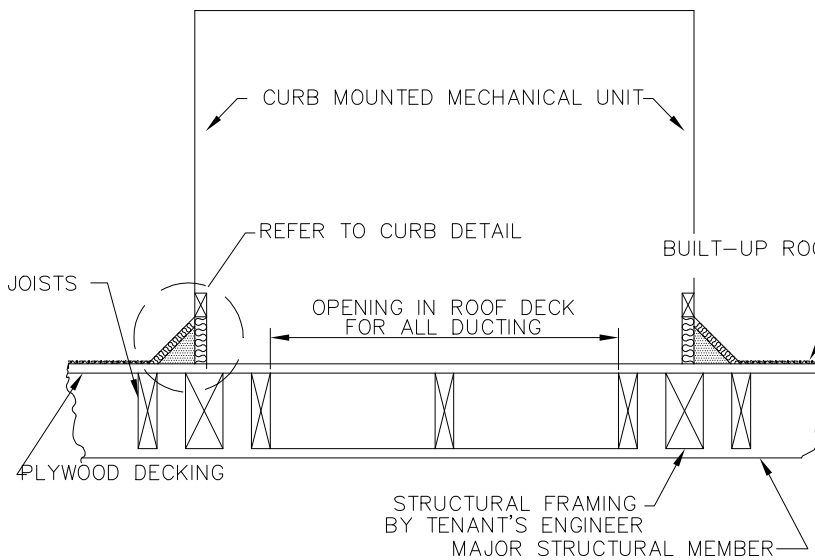

SECTION 1

NOT TO SCALE

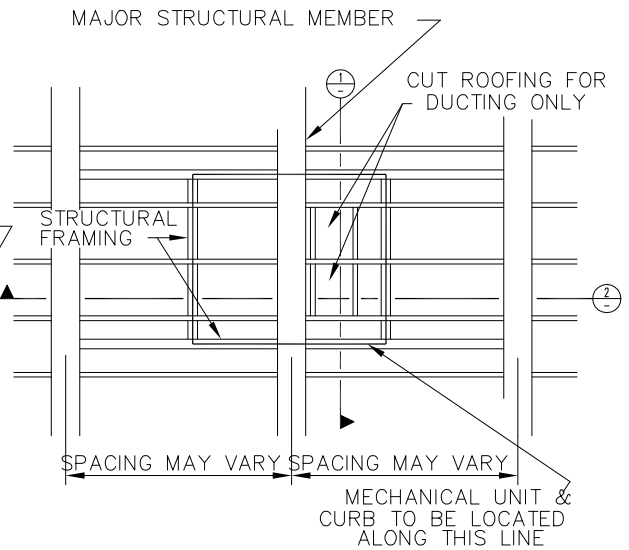

HVAC FRAMING LAYOUT

NOT TO SCALE

HVAC NOTES:


1. THE HVAC UNIT SHALL BE LOCATED OVER A STRUCTURAL BEAM.
2. DO NOT REMOVE ANY STRUCTURAL OR ANY MISC. STEEL INCLUDING BRIDGING AND OR BLOCKING.
3. THE TENANT IS RESPONSIBLE TO PROVIDE VERIFICATION BY A STRUCTURAL ENGINEER THAT THE HVAC UNIT IS ADEQUATELY SUPPORTED.
4. IF ANY OF THE REQUIREMENTS CAN NOT BE ACHIEVED, IT IS THE TENANTS RESPONSIBILITY TO NOTIFY THE LANDLORD IN WRITING AND SUBMIT AN ALTERNATE PLAN.
5. DETAILS ON THIS SHEET DO NOT NECESSARILY APPLY TO ALL TENANT SPACES. TENANTS MUST VERIFY WHICH CONDITIONS EXIST IN THEIR OWN LOCATION.

NOTE:

DETAILS ON THIS SHEET DO NOT NECESSARILY APPLY TO ALL TENANT SPACES. TENANTS MUST VERIFY WHICH CONDITIONS EXIST IN THEIR OWN LOCATIONS.

NOTE:


THE CRICKET SHOWN HERE DOES NOT NECESSARILY REPRESENT ALL CONDITIONS THIS IS AN EXAMPLE ONLY SHOWING CURB INSTALLATION W/A MINIMUM OF 8" ABOVE FINISHED ROOF STRUCTURE.

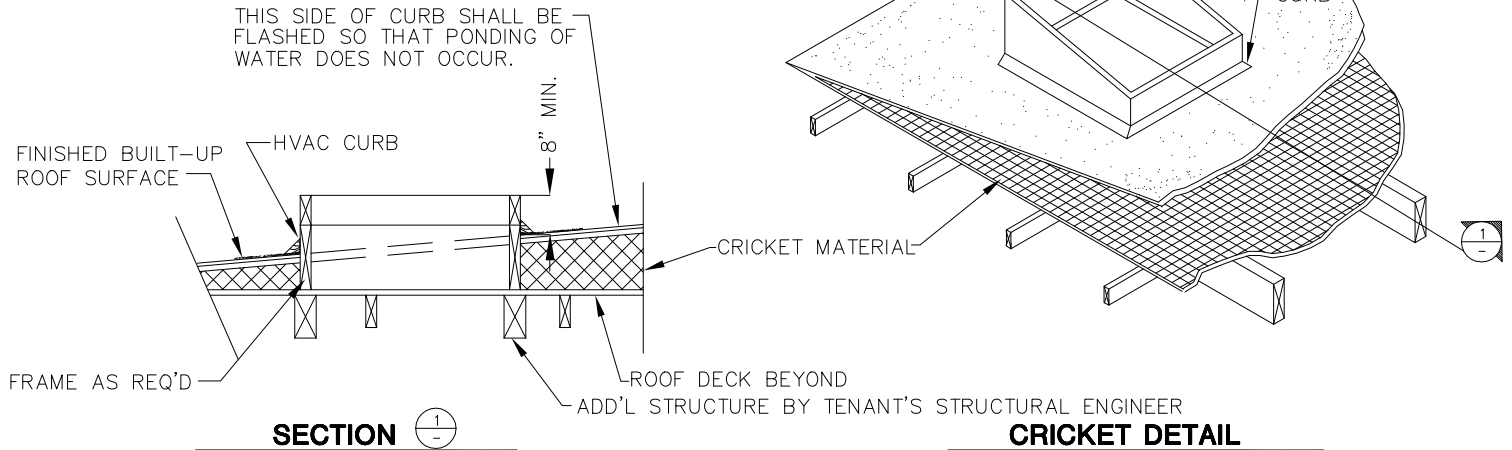

NOTE:

ALL ROOF PENETRATIONS & CUTTING AND PATCHING OF BUILT-UP ROOF BY MALL ROOFING SUBCONTRACTOR AT THE EXPENSE OF THE TENANT.

WOOD CANTS -SHALL BE SOLID ROT PROOF WOOD, USING WATER BASE TREATMENT SUCH AS WOLMAN® FIBER CANTS COMPLYING WITH FEDERAL SPECIFICATION LL-1-535 OR ASTM C729 ARE ACCEPTABLE. BUILT-IN METAL CANTS ARE NOT ACCEPTABLE.

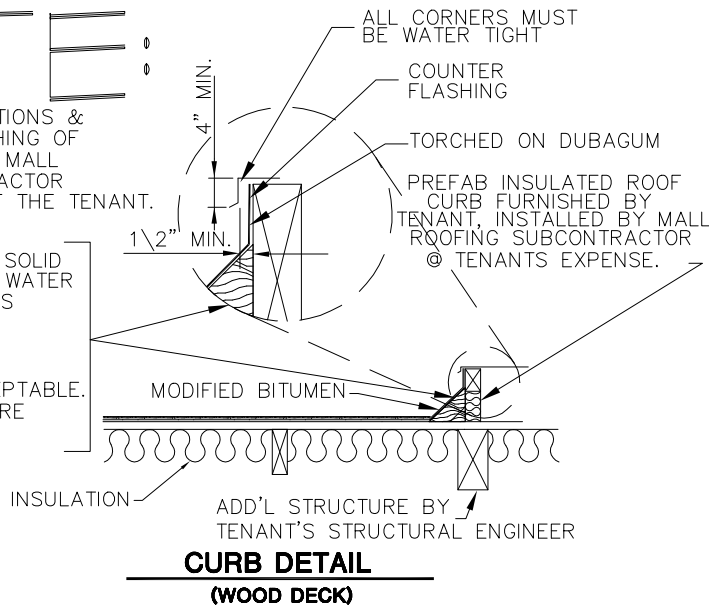


WOOD STRUCTURE

NOTE:

1. DETAILS ON THIS SHEET DO NOT NECESSARILY APPLY TO ALL TENANT SPACES. TENANTS MUST VERIFY WHICH CONDITIONS EXIST IN THEIR OWN LOCATIONS.
2. ANY ROOF PENETRATION OVER 100 SQ INCHES WILL BE REINFORCED BY INSTALLING NOT SMALLER THAN A 3" X 3" X 1/4" ANGLE FRAME AROUND OPENING TO SUPPORT A METAL ROOF DECK; OR FOR WOOD DECKS USING 4" X 8" FRAMING STUDS. ALSO THE AIR COMPRESSOR SIDE OF AN HVAC UNIT SHALL BE LOCATED OVER A STRUCTURAL MEMBER FOR ADDED SUPPORT. ONLY USE MALL ROOFER FOR ANY ROOF REPAIRS.
3. THE TENANT MUST CONTRACT WITH AN OUTSIDE HVAC CONTRACTOR FOR THE REGULAR REPAIR AND MAINTENANCE OF THE SYSTEM AND PROVIDE PROOF OF SUCH CONTRACT TO THE LANDLORD.

NOTES:

1. ALL ROOF PENETRATIONS SHALL BE MADE BY MALL ROOFING SUBCONTRACTOR AT TENANT'S EXPENSE.
2. SHEET LEAD MIN. OF 2 1/2 LB. PER SQ. FT.

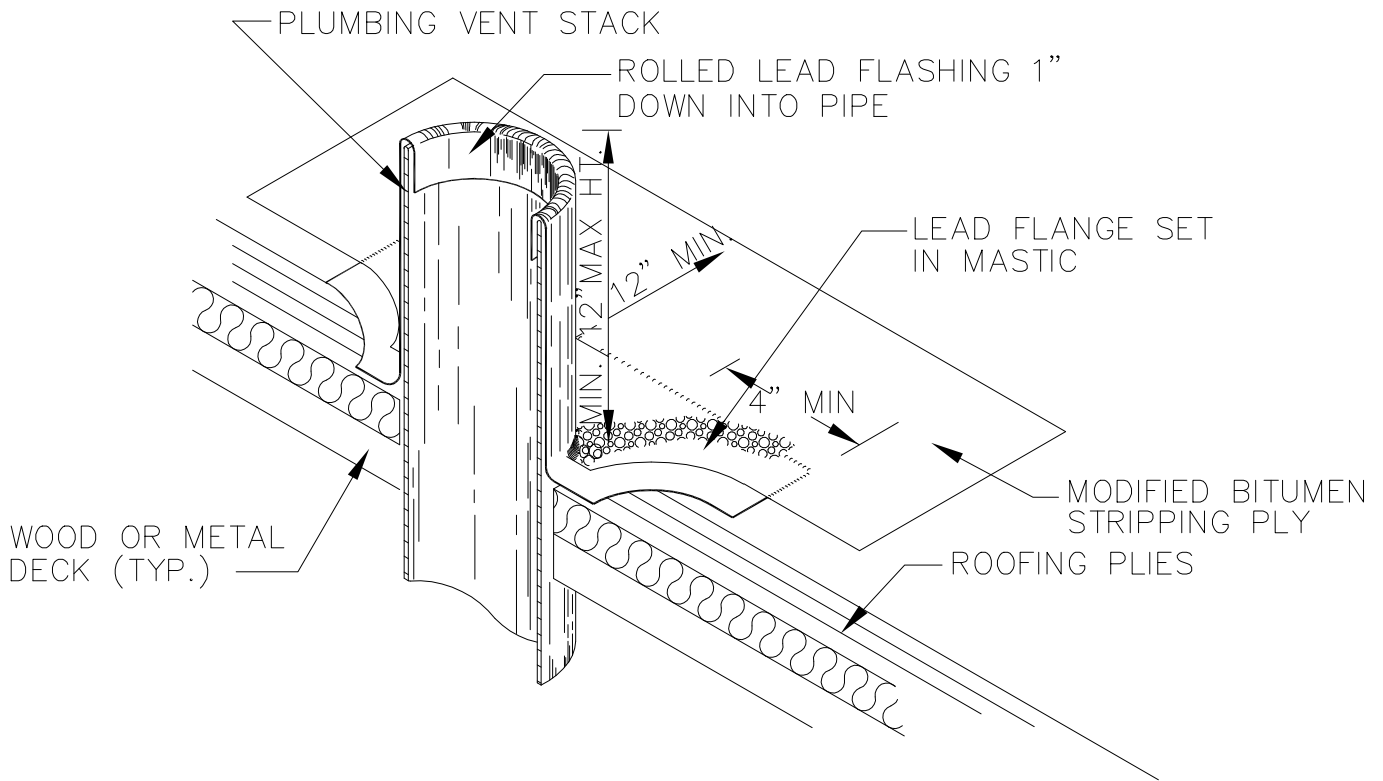

VENT THRU ROOF DETAIL

NOTE

DETAILS ON THIS SHEET DO NOT NECESSARILY APPLY TO ALL TENANT SPACES. TENANTS MUST VERIFY WHICH CONDITIONS EXIST IN THEIR OWN LOCATIONS.