


CURB DETAIL

HVAC ROOFTOP UNIT
ON FACTORY CURB
OVER TENANT SPACE

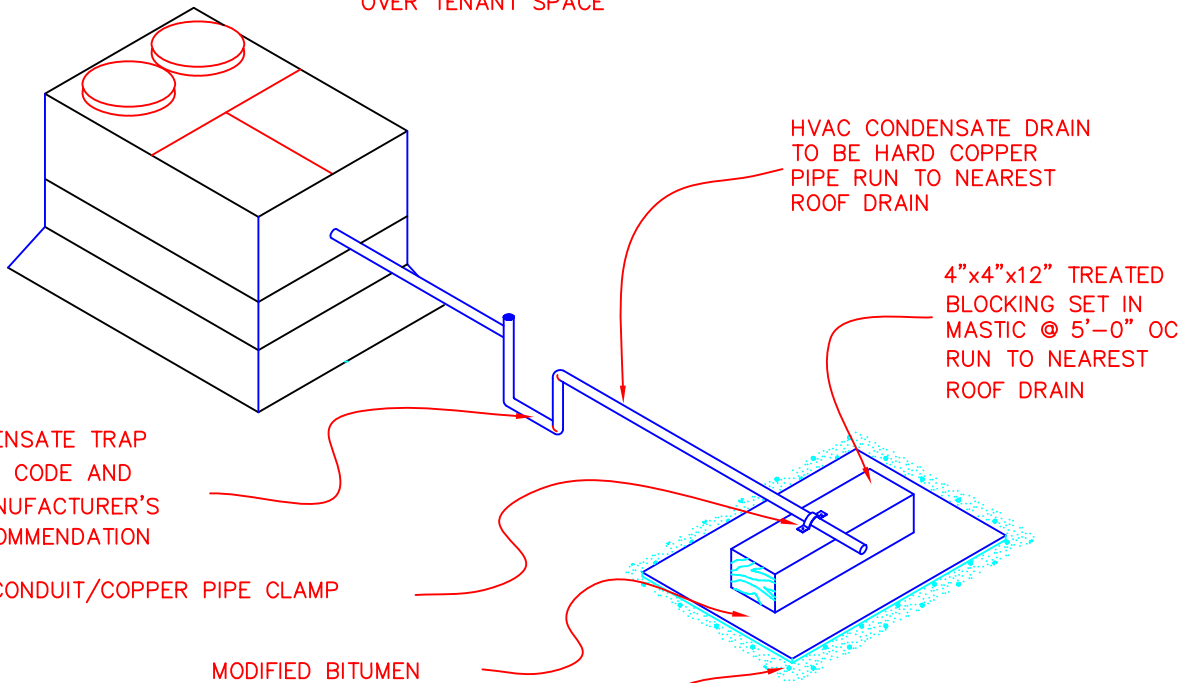

HVAC ROOF TOP UNIT


CONDUIT/PIPE SUPPORT DETAIL

NOTES:

ALL ROOF PENETRATIONS & CUTTING AND PATCHING OF BUILT-UP ROOF BY MALL ROOFING SUBCONTRACTOR AT THE EXPENSE OF THE TENANT.


PREFAB INSULATED ROOF CURB FURNISHED BY THE TENANT, INSTALLED BY THE MALL ROOFING SUBCONTRACTOR @ TENANTS EXPENSE.

MECHANICAL UNIT
INSTALLATION DETAILS
HVAC DETAILS-1

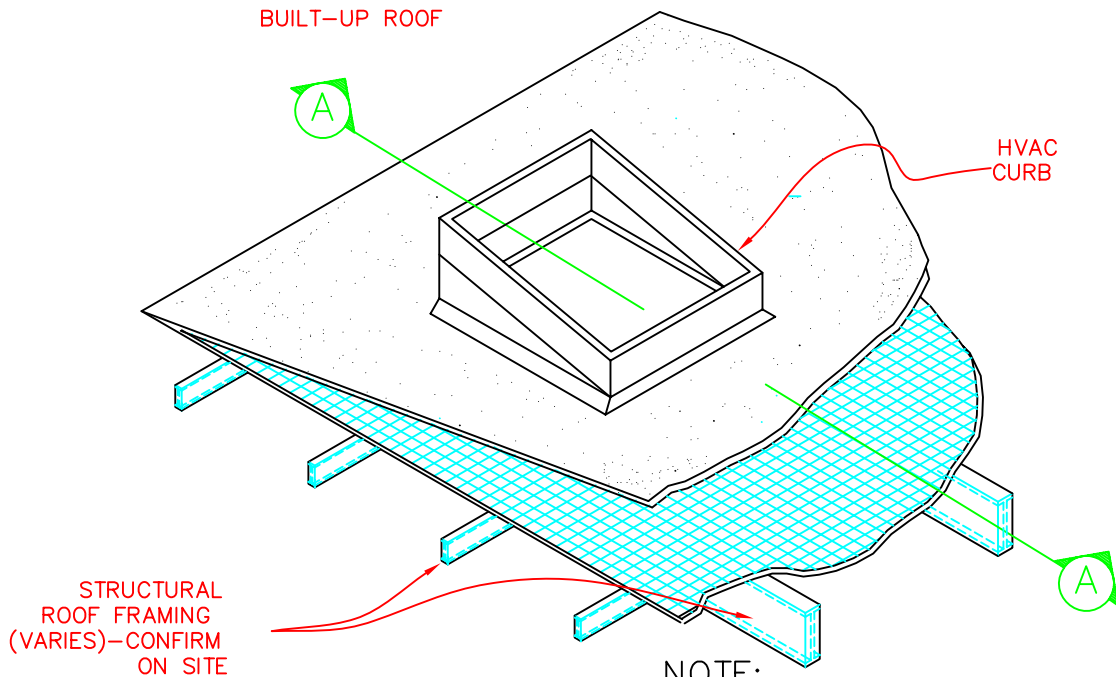


CRICKET DETAIL

NOTE:
 THE CRICKET SHOWN HERE DOES NOT NECESSARILY REPRESENT ALL CONDITIONS THIS IS AN EXAMPLE ONLY SHOWING CURB INSTALLATION W/A MINIMUM OF 8" ABOVE FINISHED ROOF STRUCTURE.

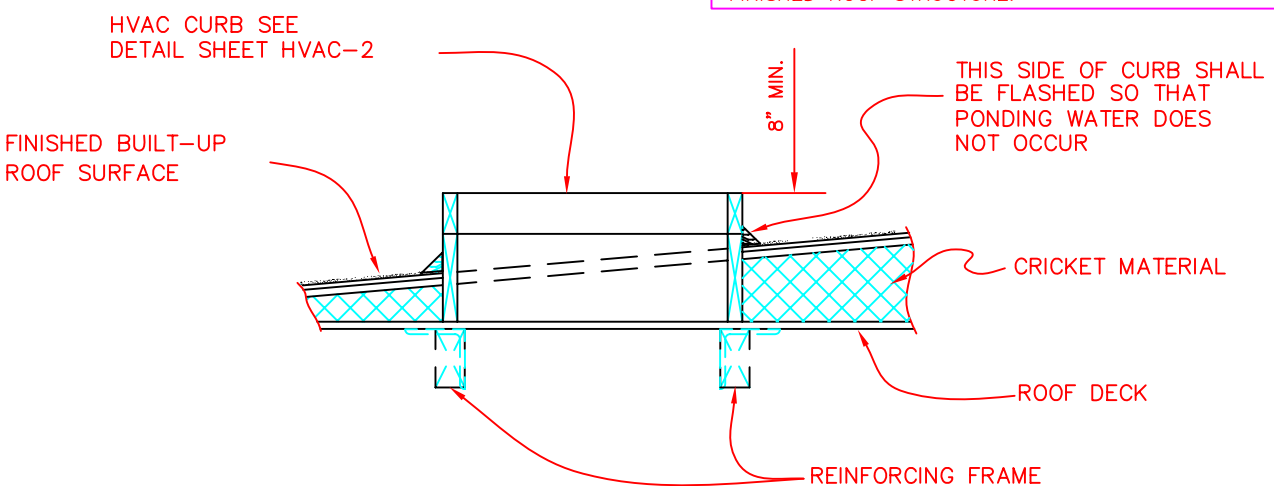

- NOTES:
1. ALL ROOF PENETRATIONS OVER 100 SQUARE INCHES REQUIRED BY THE TENANT SHALL BE REINFORCED BY THE ADDITION OF FRAMING SURROUNDING THE OPENING. ALL REINFORCING SHALL BE DONE ACCORDING TO THE DIRECTION OF THE TENANT'S STRUCTURAL ENGINEER. AS A GENERAL GUIDELINE FRAMING SURROUNDING THE OPENING SHOULD NOT BE LESS THAN A 3X3X1/4 ANGLE FOR METAL STRUCTURES, OR 4X8 FOR WOOD STRUCTURES
 2. COMPRESSOR SIDE OF THE HVAC UNIT SHOULD BE LOCATED OVER A MAJOR STRUCTURAL MEMBER FOR SUPPORT.
 3. THE TENANT WILL INSTALL ANY ADDITIONAL FRAMING NECESSARY TO REINFORCE THE LANDLORD'S ROOF STRUCTURE FOR THE SUPPORT OF THE TENANT'S ROOF TOP EQUIPMENT.
 4. THE TENANT MUST CONTRACT WITH AN OUTSIDE HVAC CONTRACTOR FOR THE REGULAR REPAIR AND MAINTENANCE OF THE SYSTEM AND PROVIDE PROOF OF SUCH CONTRACT TO THE LANDLORD.

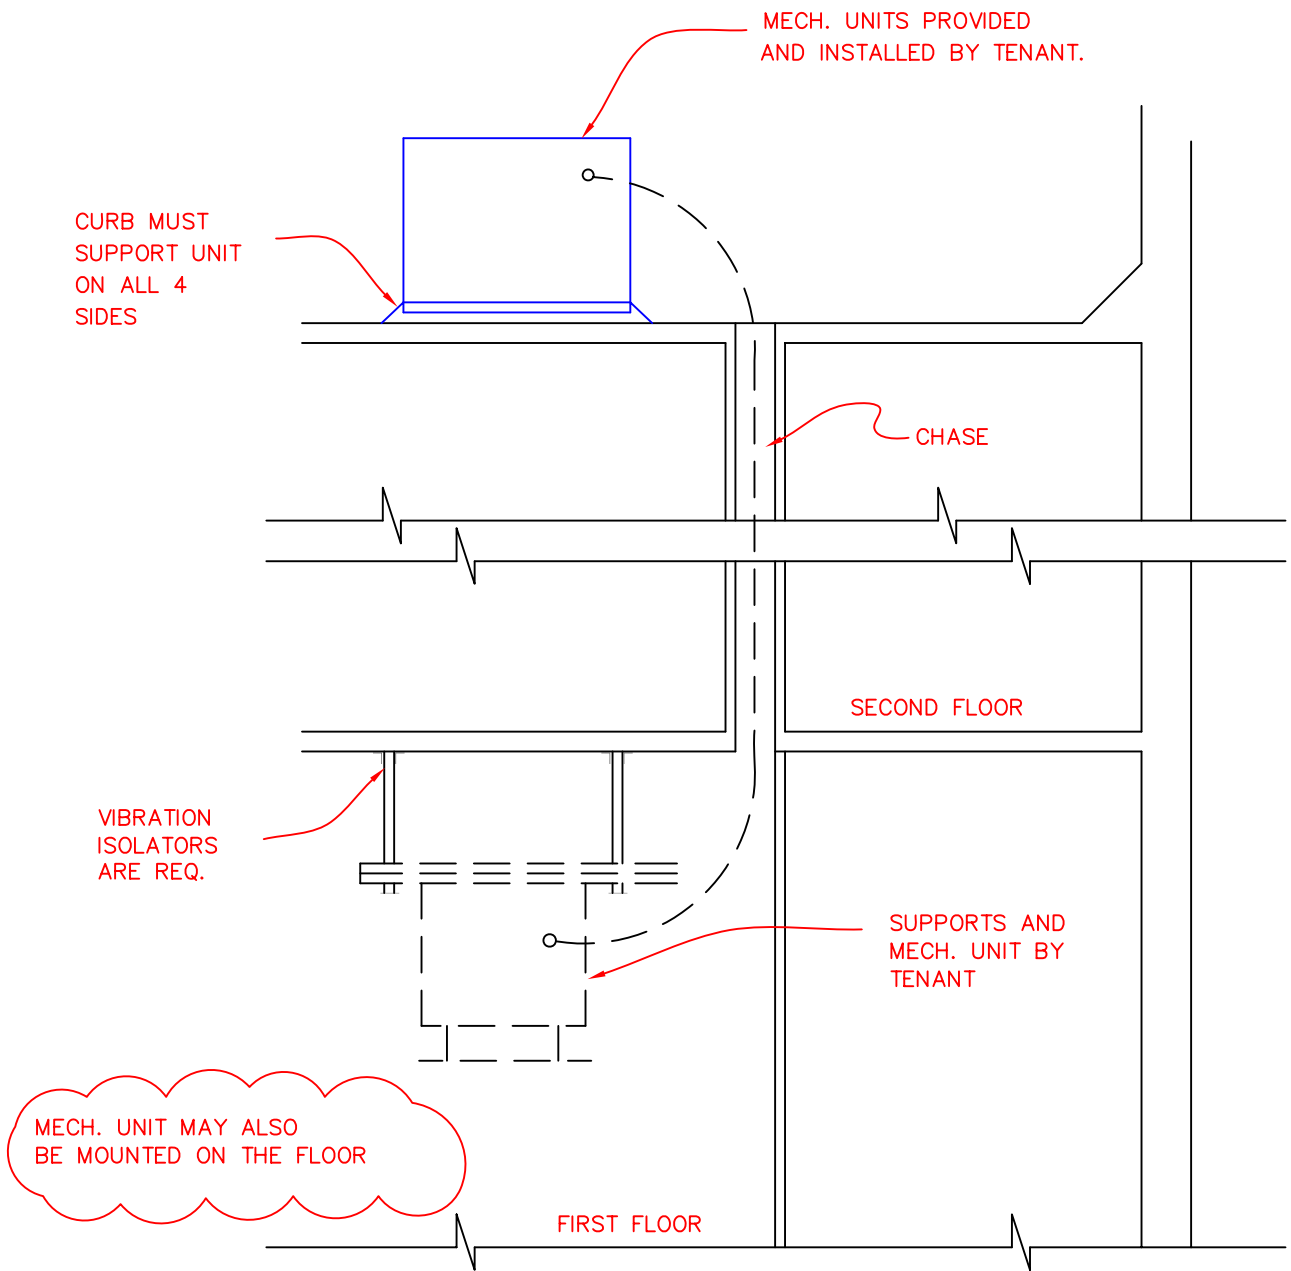

NOTE:


TENANT IS RESPONSIBLE TO PROVIDE VERIFICATION BY A STRUCTURAL ENGINEER THAT THE HVAC UNIT IS ALL SPLIT SYSTEM HVAC UNITS MOUNTED ON ROOF DECK MUST BE SET ON FOUR SIDED FACTORY CURB.

MECH. UNITS PROVIDED AND INSTALLED BY TENANT MUST BE LOCATED DIRECTLY OVER TENANT SPACE.

ROOF PENETRATION AND PITCH POCKET BY MALL ROOFER.


SPLIT SYSTEM INSTALLATIONS HVAC DETAILS-3

CABLE TAP BOX ASSEMBLY W/
2-100 A, 3 POLE FUSED SW.
FURNISHED AND INSTALLED BY
LANDLORD'S ELEC. CONTRACTOR.
FUSES AND REDUCER CLIPS IN-
STALLED BY TENANT'S ELEC.
CONTRACTOR AS SHOWN.

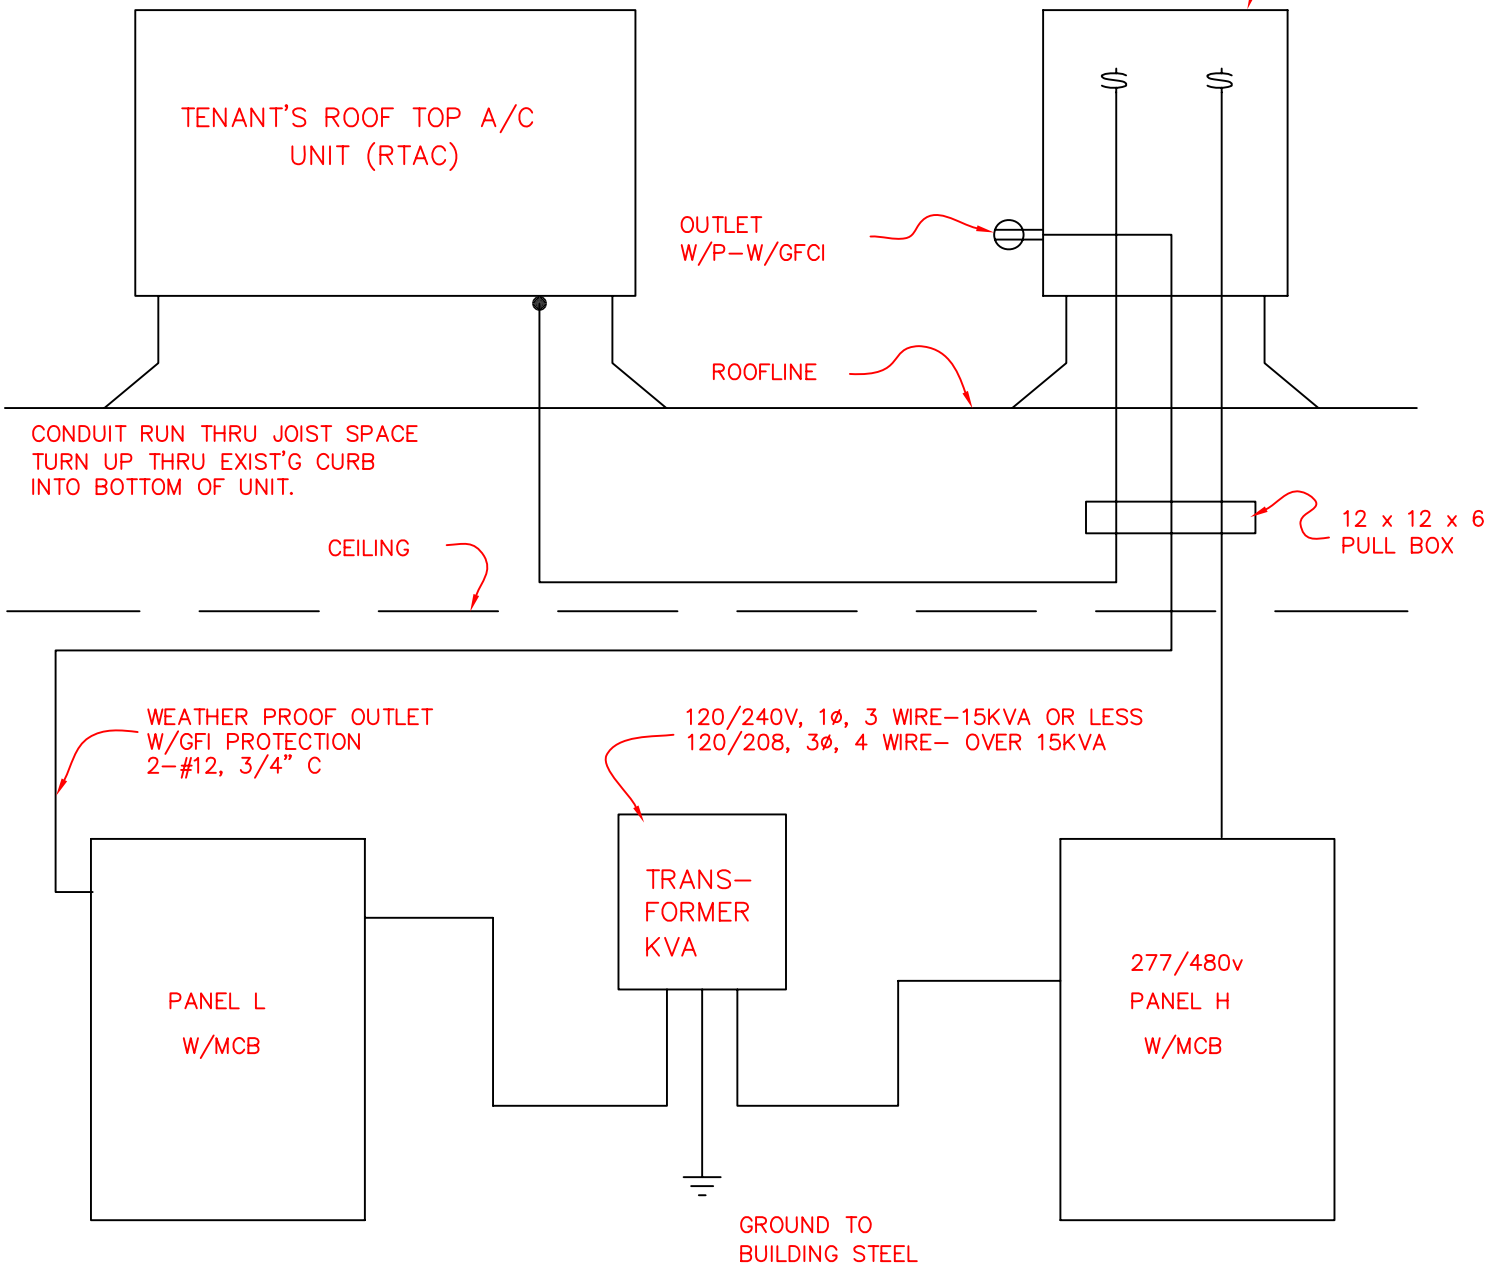


CABLEBUS SYSTEM- PLAN A
SOUTHRIDGE MALL
ELECTRICAL DETAIL-1

CABLE TAP BOX ASSEMBLY W/
 2-100 A, 3 POLE FUSED SW.
 FURNISHED AND INSTALLED BY
 LANDLORD'S ELEC. CONTRACTOR.
 FUSES AND REDUCER CLIPS IN-
 STALLED BY TENANT'S ELEC.
 CONTRACTOR AS SHOWN.

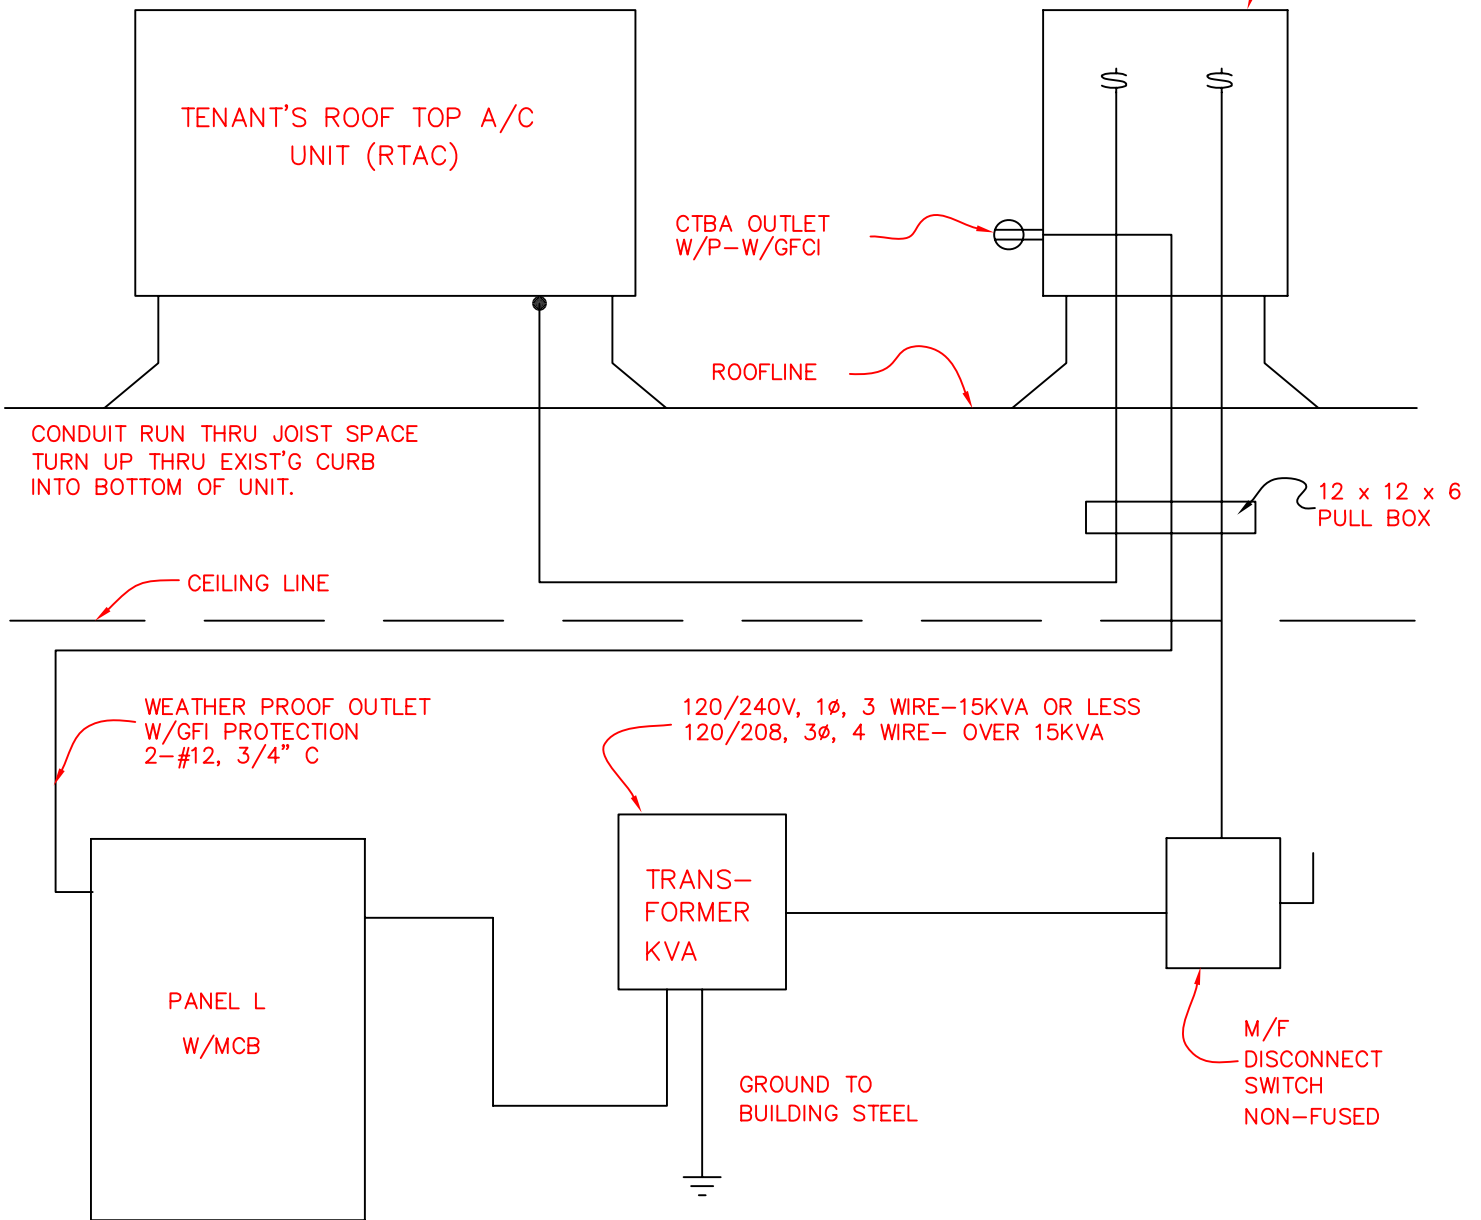


* NON-AUTOMATIC CIRCUIT INTERRUPTER
 OR NON-FUSIBLE SWITCH MAY BE USED
 FOR THIS FUNCTION.

CABLEBUS SYSTEM PLAN A
 (WITHOUT 277/480 PANEL)
 SOUTHRIDGE MALL
 ELECTRICAL DETAIL-2

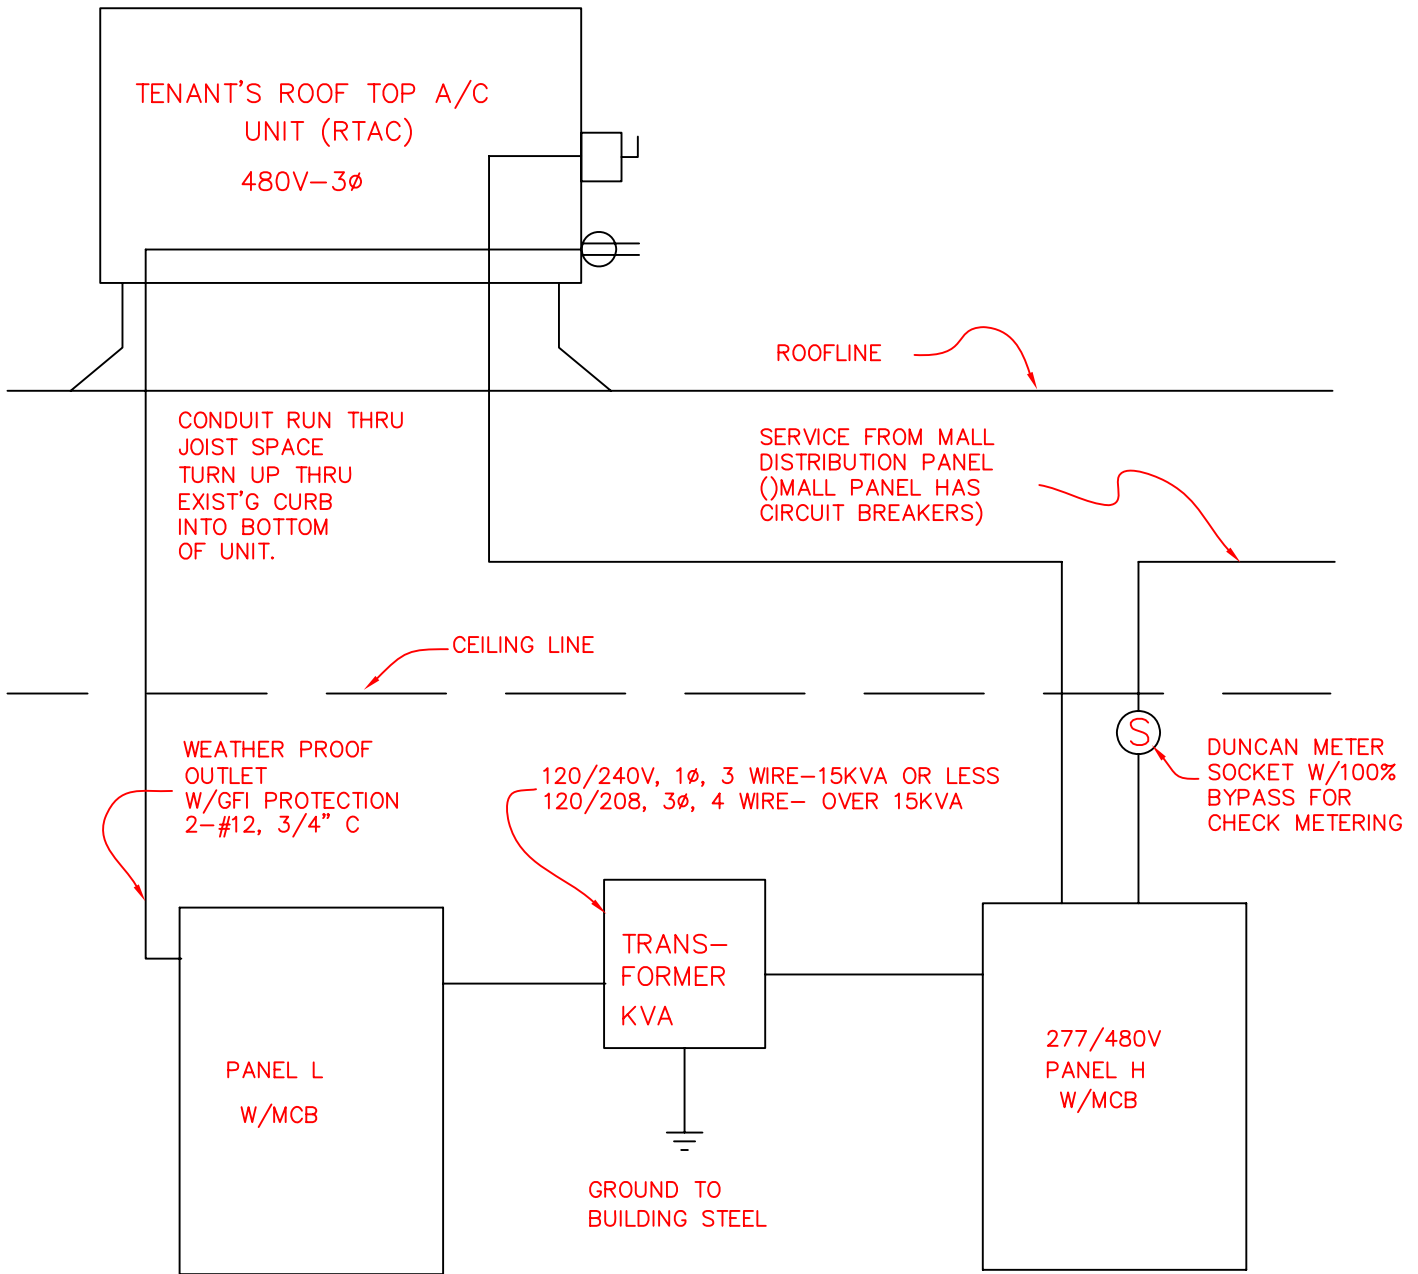

PLAN B-ELECTRICAL DISTRIBUTION DIAGRAM
SOUTHRIDGE MALL
ELECTRICAL DETAIL-3

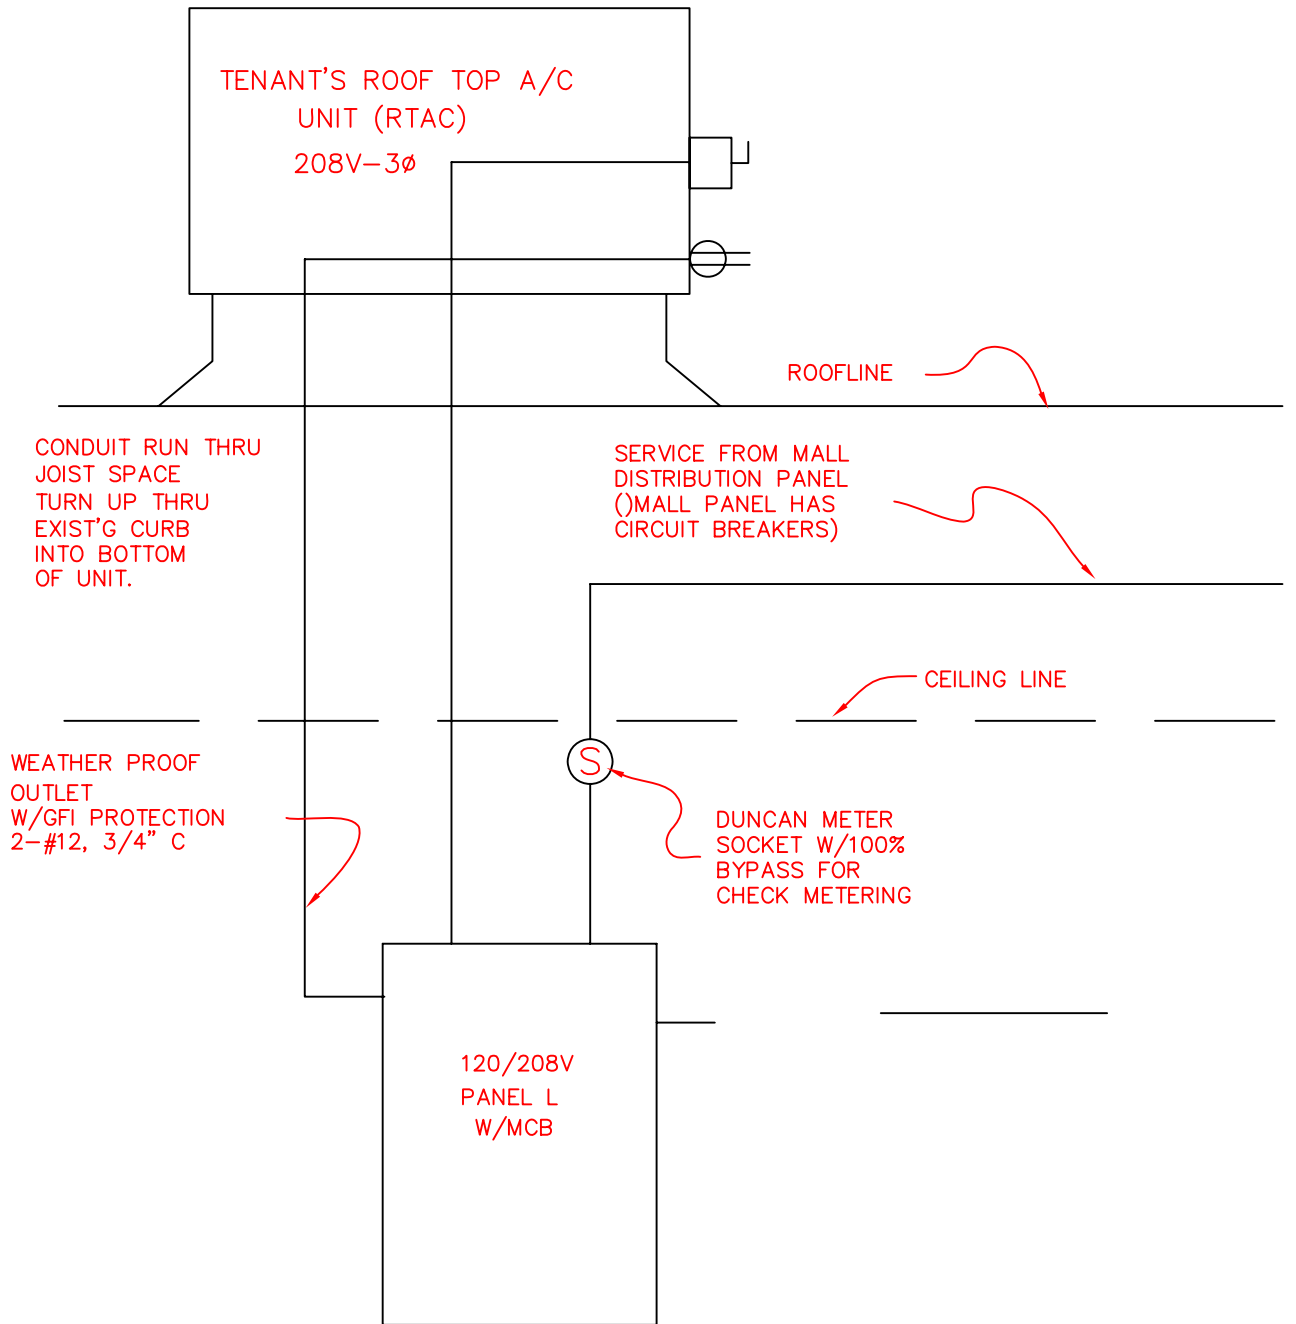

PLAN C-ELECTRICAL
DISTRIBUTION DIAGRAM
SOUTHRIDGE MALL
ELECTRICAL DETAIL-4